


115E | Simple Lasso

Electrical: MC/AC cable | 5/8 - 3 in. | Listed: ICC-ES PMG-1840

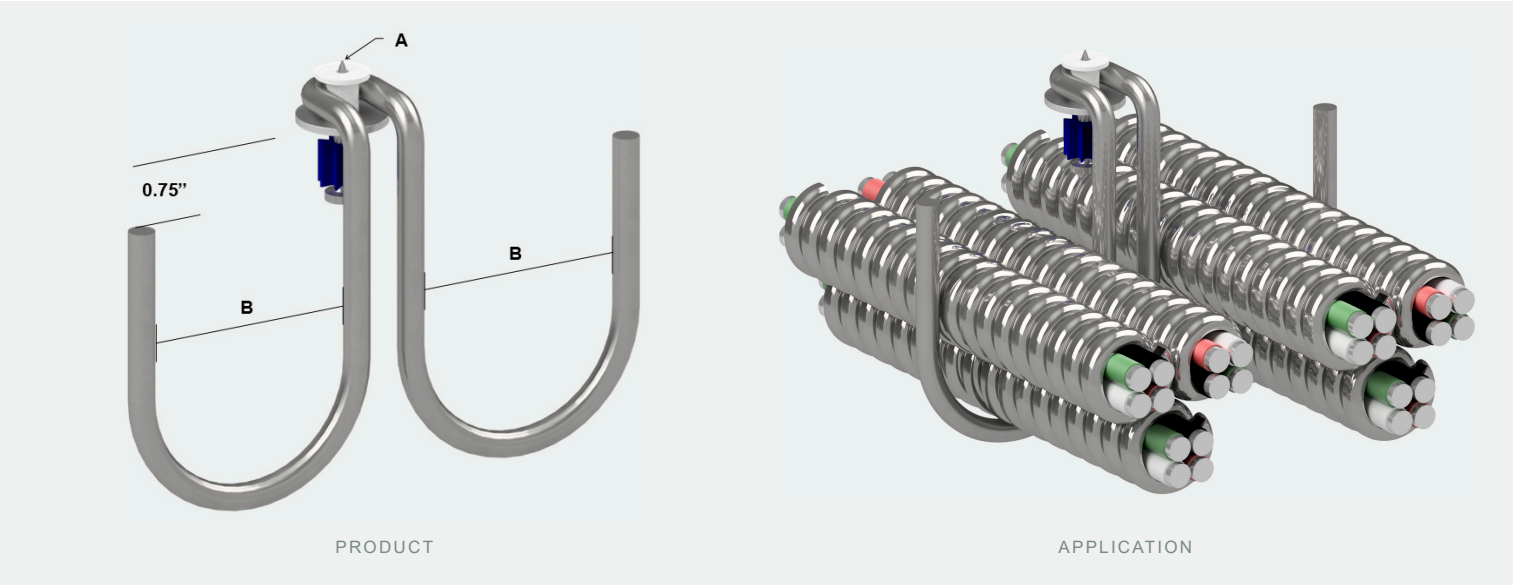

01 CAPACITY

Rated load 50 lbs, listed per ICC-ES PMG-1840 Table 1 (September 2026). The published capacity of the configured assembly is **50 lbs** with every fastener option in its listed substrate: each option meets or exceeds the support rating, so the support governs.

The rated load applies to the support assembly; the attachment to structure is evaluated separately. The fastener backup documents (F sheets) are furnished upon request, and a configured assembly sheet is issued per project with the selected fastener and its substrate capacities.

02 ORDERING

Segment	Selection	Description
A	Fastener, by substrate	Power actuated pins and post nuts: A001 PD157-100W, A01 PD157-114W, A02 PD157-112W, A03 PD157-100NR, A04 PD157-114NR, A05 PD157-112NR. Concrete anchors: A20 7404SD1-PWR, A21 7413SD2-PWR, A30 PFM1411060. Wood fasteners: A40 TB250, A50 HL14200. Sheet steel: A60 HWD10114. Steel clips (sidemount only): A71 BC50, A72 PC25, A73 HBC25, A74 HBC50.
B	Size	B01 1 in. lasso ID. B015 1-1/2 in. lasso ID. B02 2 in. lasso ID. B025 2-1/2 in. lasso ID. B03 3 in. lasso ID.

Built to order.

03 NOTES

Secures a bundle of MC/AC cable or flexible conduit with one shot; select the lasso ID for the bundle.

- Secures MC/AC cable and flexible conduit bundles.
 - Bundling: NEC 310.15(C)(1) requires ampacity adjustment where cables are bundled longer than 24 in. without maintaining spacing. Per 310.15(C)(1)(d) no adjustment applies to MC/AC cable without an overall jacket, 12 AWG copper, not more than three current-carrying conductors per cable and not more than 20 current-carrying conductors in the bundle; above 20, 310.15(C)(1)(e) applies a 60 percent factor.
 - Designed for demanding high-rise construction.
 - Rigid connection to structure eliminates the need to tie off to the ceiling grid below. NEC 300.11(A).
 - Finish: zinc plated.
 - Support spacing governed by the applicable local building code.
- Dry locations only, per the listing.
 - Rated load carries a minimum 4:1 factor of safety on ultimate tested capacity per ICC-ES LC1041 and UL 2239.
 - The rated load applies to the support assembly only; the attachment to structure is evaluated separately (Section 01).
 - Seismic: per ASCE 7, power actuated fasteners are limited to 90 lbs of tension in Seismic Design Categories C (I_p = 1.5), D, E and F. The capacity published here is already at or below that limit, so it is unchanged on a seismic project.
 - Drawings not to scale.